




Spiral Vibration Damper and FIBERLIGN® Dielectric Damper

Subset Method of Applying Two Spiral Vibration Dampers or Dielectric Dampers

Be sure to read and completely understand this procedure before applying product. Be sure to select the proper PREFORMED™ product before installation.

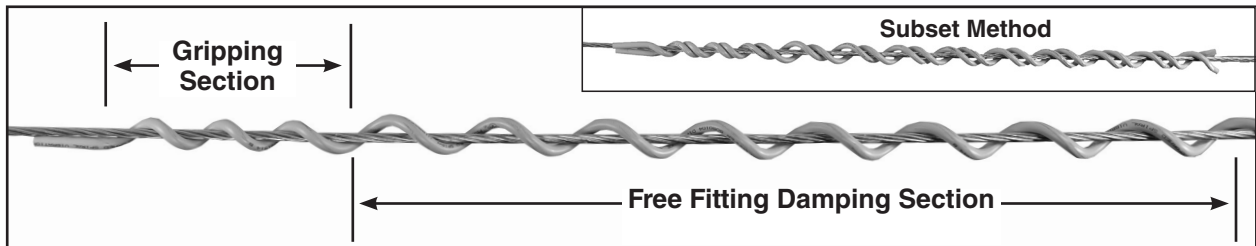

Subset Method

Spiral Vibration Damper or Dielectric Damper as received at job site.


STEP #1 Subset the two Spiral Vibration Dampers or Dielectric Dampers by winding the two together. Position the dampers on the conductor or ADSS cable with the gripping section toward the support point. Wrap the damping section of the damper around the conductor one full wrap.



STEP #3 Continue applying the dampers onto the conductor until the gripping section is reached. They should be positioned at least one hand's width away from Armor Rods, structural reinforcing rods of a FIBERLIGN Dielectric Dead-end or other support hardware.




STEP #2 Slide the dampers away from the support point while spiraling or twisting the dampers onto the conductor.

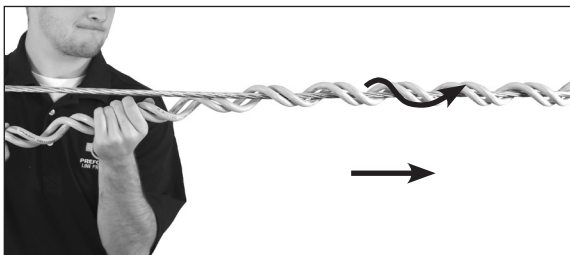

CAUTION: For installation of Dielectric Dampers where the ADSS cable is in an EHV field, the Dielectric Dampers must be positioned 15 feet away from suspensions and dead-ends to eliminate electrical tracking of the damper and/or cable.


STEP #4 Grasp each of the legs and separate them as shown below.

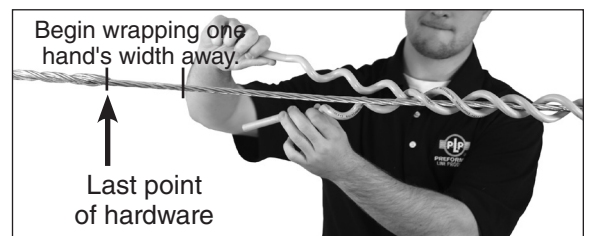

STEP #5 Wrap one of the dampers onto the conductor or cable. Next, wrap on the other damper in the same manner.



STEP #7 Completed subset application of the Spiral Vibration Damper or Dielectric Damper shown below.

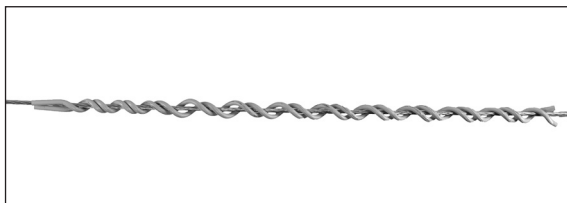

STEP #6 Snap the ends of the dampers into place by applying light thumb pressure.



Use this QR Code to find Application Procedure (SP2130) Spiral Vibration Damper on www.preformed.com.

SAFETY CONSIDERATIONS

This application procedure is not intended to supersede any company construction or safety standards. This procedure is offered only to illustrate safe application for the individual.

FAILURE TO FOLLOW THESE PROCEDURES MAY RESULT IN PERSONAL INJURY OR DEATH.

This product may be removed and reinstalled during the initial installation if it is in good condition. After extended service life, it is recommended the product not be reused once removed from service.

Do not modify this product under any circumstances.

This product is intended for use by trained technicians only. **This product should not be used by anyone who is not familiar with, and not trained to use it.**

When working in the area of energized lines, extra care should be taken to prevent accidental electrical contact.

For proper performance and personal safety, be sure to select the proper size PREFORMED product before application.

PREFORMED products are precision devices. To insure proper performance, they should be stored in cartons under cover and handled carefully.



PREFORMED LINE PRODUCTS

P.O. Box 91129, Cleveland, Ohio 44101 • 440.461.5200 • www.preformed.com • e-mail: inquiries@preformed.com

SP3278