

APPLICATION PROCEDURE & SAFETY CONSIDERATIONS PREFORMED LINE PRODUCTS



FEBRUARY 2004

CUSHION-GRIP™ Spacer Damper

Be sure to read and completely understand this procedure before applying product. Be sure to select the proper PREFORMED™ product before installation.

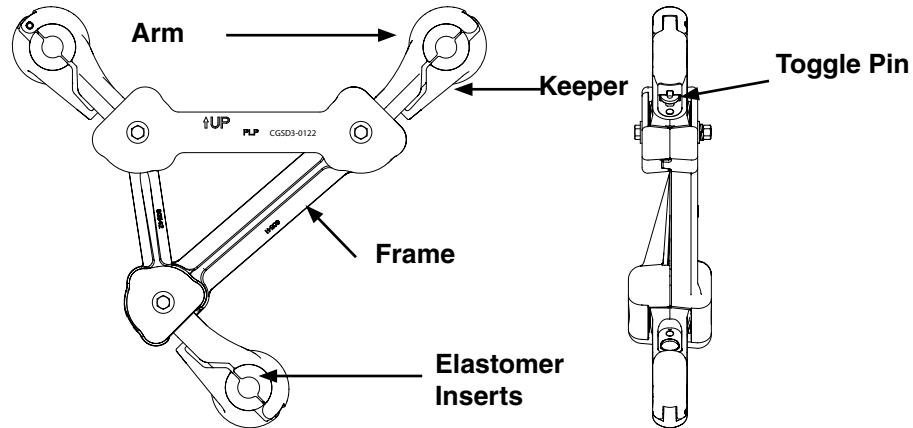


FIGURE 1 - NOMENCLATURE

1.00 OPEN KEEPERS

1.01 Position Installation tool over indentations on arm and keeper, and compress. (Figure 2)

1.02 Rotate toggle pin 90° and release tool to allow keeper to fall open. (Figure 3)

NOTE: Be sure that the adjustment of the tool will allow sufficient movement of the keeper to allow the toggle pin to be rotated.



**FIGURE 2 - POSITION
INSTALLATION TOOL**



FIGURE 3 - KEEPER IN OPEN POSITION

1.03 Repeat for each arm

2.00 POSITION SPACER DAMPER ON CONDUCTORS

2.01 Position Spacer Damper on conductors noting the orientation (up arrow) molded on the frame. Be sure that the Spacer Damper sits squarely on each conductor. (Figure 4)



FIGURE 4 - POSITION SPACER DAMPER ON CONDUCTOR

3.00 CLOSE KEEPERS

- 3.01 Position Installation tool as before in step 1.01.
- 3.02 Rotate Toggle Pin 90°.
- 3.03 Ensure that the head of the toggle pin is turned a full 90° and located within the positioning groove on the Keeper. (Figure 5)



FIGURE 5 - POSITION SPACER DAMPER ON CONDUCTOR

- 3.04 Repeat for each arm.

4.00 SAFETY CONSIDERATIONS

- 4.01 This Application Procedure is not intended to supersede any company construction or safety standards. This procedure is offered only to illustrate safe application for the individual. **CAUTION: FAILURE TO FOLLOW THESE PROCEDURES AND RESTRICTIONS MAY RESULT IN PERSONAL INJURY OR DEATH.**
- 4.02 This product is intended for the specified application. **CAUTION: DO NOT MODIFY THIS PRODUCT UNDER ANY CIRCUMSTANCES.**
- 4.03 This product is intended for use by trained craftspeople only. This product **SHOULD NOT BE USED** by anyone who is not familiar with and trained in the use of it.
- 4.04 When working in the area of energized lines with this product, **EXTRA CARE** should be taken to prevent accidental electrical contact.
- 4.05 For **PROPER PERFORMANCE AND PERSONAL SAFETY** be sure to select the proper size **PREFORMED** products before application.
- 4.06 **PREFORMED** products are precision devices. To insure proper performance, they should be stored in cartons under cover and handled carefully.

PREFORMED LINE PRODUCTS



P.O. Box 91129, Cleveland, Ohio 44101 • 440.461.5200 • www.preformed.com • e-mail: inquiries@preformed.com

SP2974